



BIO & BIM VS MF SEALING WAX

DURING THE SEALING WAX
PROCESS


BIO & BIM

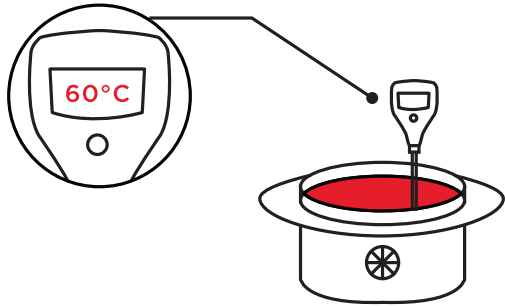


Application temperature
58°C a 65°C

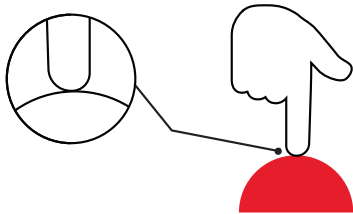

Firmer to touch




Does not leave highly visible marks
when touched

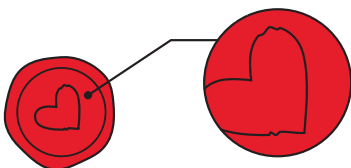


Clear high relief is harder to achieve
when stamping a seal with BIO formula.
It can be good with BIM formula

MF

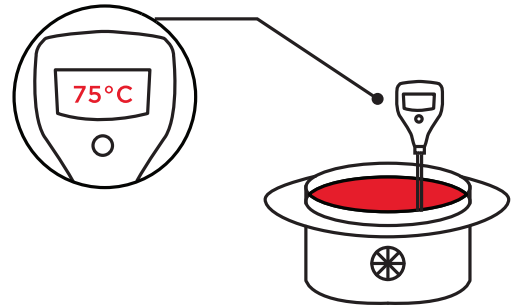


Application temperature


73°C a 88°C

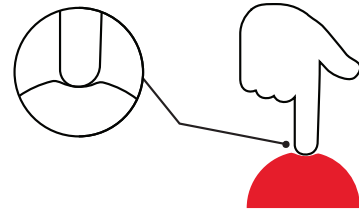

Softer to touch




May leave superficial marks
if it is touched when it is still warm

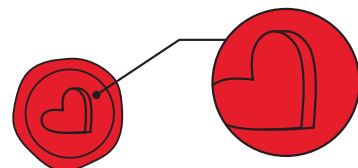


Easier to get a good high relief
when stamping a seal

BIO & BIM VS MF SEALING WAX


BIO & BIM



Formula contains 100% natural beeswax

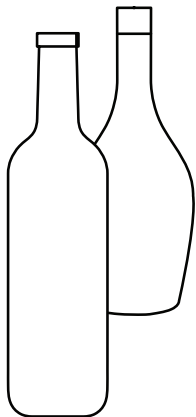


Recommended for wine foods, liquors and spitis, olive oil, etc.

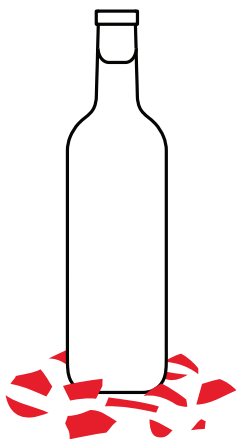


Brittle formula. When opening, wax capsule can be completely removed in large pieces from bottle and cap

MF



Vegan formula
Free of animal origin raw materials

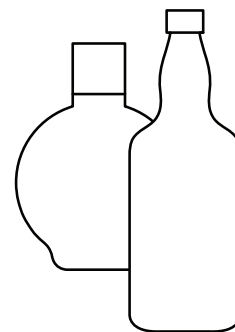

Recommended for liquors and spirits



When opening ribbon is pulled to open the bottle ,wax in cap and neck remains in place.